


SOFT TOUCH HOOKUP

WTC 6000-SERIES with PLC

Connect wires from the SOFT TOUCH cable to the control as shown below.

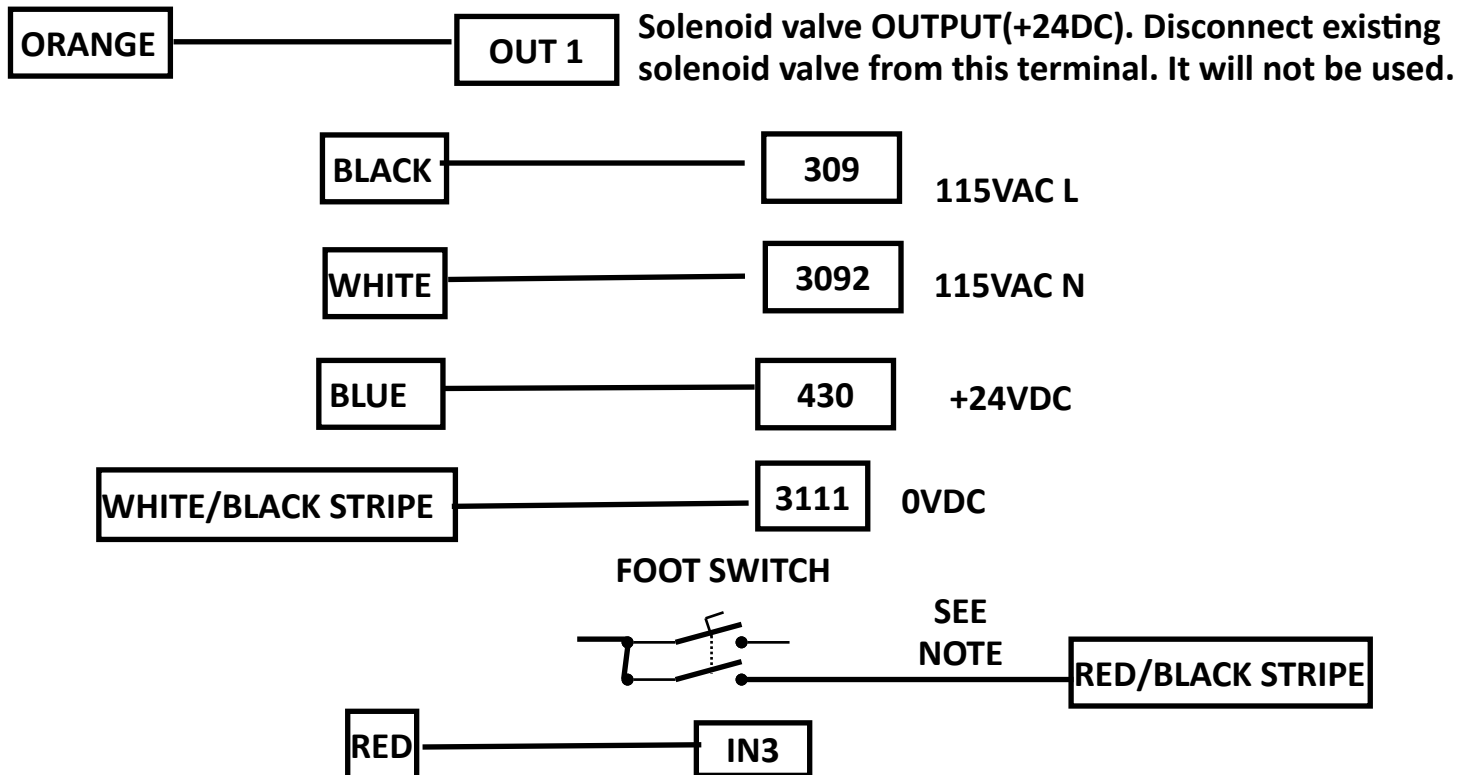

If RETRACT SOFT TOUCH option 9181-34JA or 9181-34JB is installed, add wire to OUT 0.

GREEN/BLACK STRIPE wire connects to **OUT 0**. LEAVE CONNECTED TO EXISTING RE-TRACT SOLENOID VALVE.

GREEN wire connects to the **(CABINET GROUND STUD)**.

NOTE: Disconnect stage 2 wire from terminal IN3 and connect it to the **RED/BLACK STRIPE** wire. Connect **RED** wire to terminal IN3